

Store: 2688 Rack: B For period ending: Thu, 07 Oct 2021 View

**2688 B [RACK B]** Emerson Tyler, TX

Date range: Tue Oct 05 2021 - Thu Oct 07 2021 Data Source: IoT

Last Updated: Thu, Oct 7, 2021 09:30 AM CDT

**89.8**

Overall Rack Score



Time in Target

**88.9**

Suction Score

**90.6**

Superheat Score

**2**

Open Work Orders

Circuit Performance


Circuit	# Cases	% Time in Target	Setpoint*	Avg Offset*	Case Performance
b11	1	0	-10	9	b11
b01.1	4	4	-10	5	b01.1a b01.1b b01.1c b01.1d
b08	1	18	-10	13	b08
b01.2	4	29	-10	5	b01.2a b01.2b b01.2c b01.2d
b02	4	51	-10	3	b02a b02b b02c b02d
b04	4	58	-10	3	b04a b04b b04c b04d
b03	2	63	-10	3	b03a b03b
b10.1	1	84	-2	2	b10.1
b06	4	86	24	2	b06a b06b b06c b06d
b07	2	91	24	2	b07a b07b
b10.2	1	94	-2	1	b10.2
b09	2	97	-3	1	b09a b09b
b05	2	97	-10	2	b05a b05b

Compressor Performance


Id	Run Time	% Time in Lockout	# Lockouts*	% Time in Proof Failure	# Proof Failures*
1	35.9%	0.3%	1	27.0%	4
2	56.3%	0.0%	0	0.0%	0
3	87.9%	0.0%	0	0.0%	0
4	98.8%	0.0%	0	0.0%	0

\*Number observed over analysis period

Suction Pressure Analysis

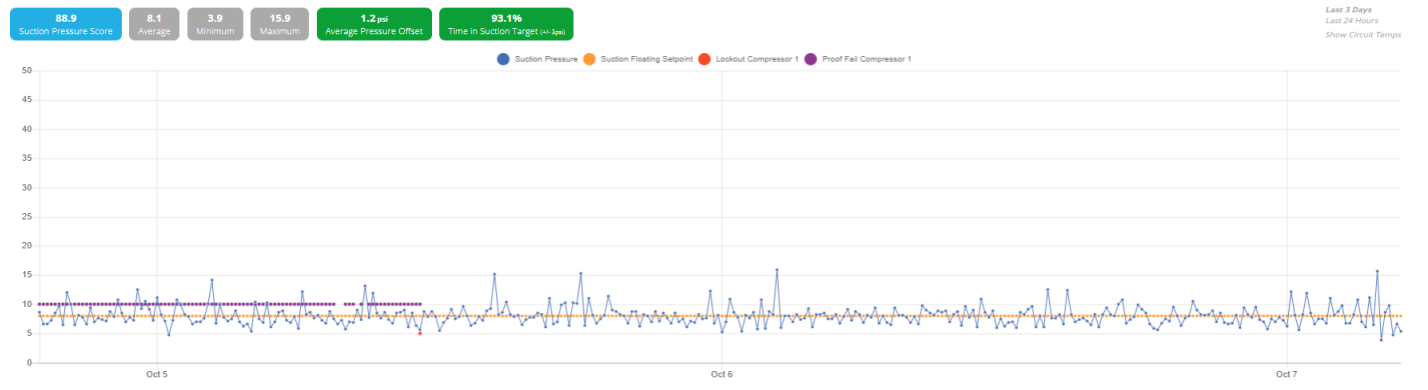

Superheat Analysis

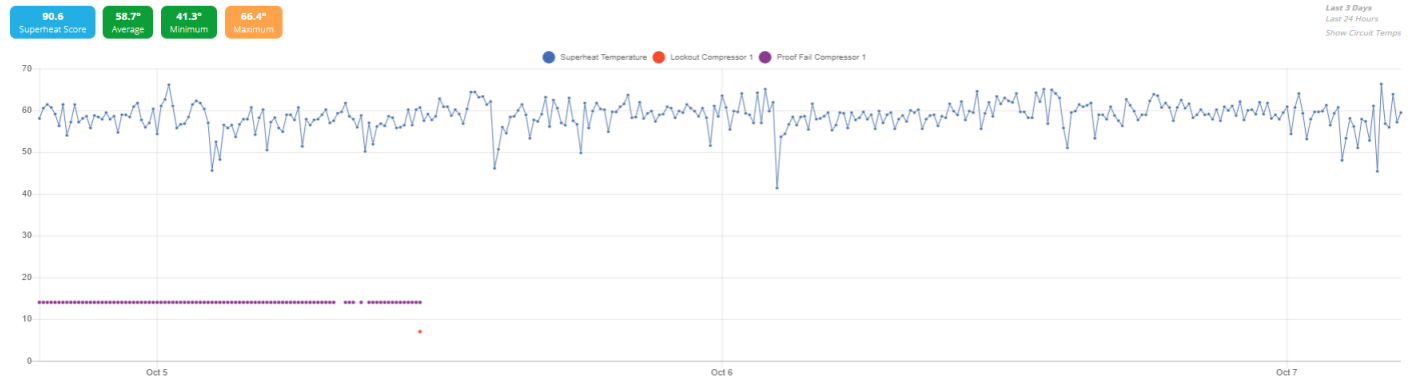

Receiver Float Level (Last 30 days)

No receiver float data available

Work Order Summary (Last 30 days)

Date Created	ID	Status	Extended	Created By	Problem	Description	Assets Referenced
10/3/2021	189108355	COMPLETED	Pending Confirmation	IoT Api User	P3-Onsite W/ 3 Days	HOME OFFICE ONLY   Refrigeration - HO Use Only   R (more)	1

9/28/2021

188581717

COMPLETED

Hvac/R Tech Complete

lot Api User

P2-Onsite W/ 48 Hours

HOME OFFICE ONLY | Refrigeration - HO Use Only | C (more)

B

C

b01.2a

b02a